


- NOTE:
1. ALL HOT LEGS TO NEUTRAL MUST READ 120 VOLTS  $\pm$  10%
  2. GREEN WIRE TO BE MECHANICAL GROUND
  3. CUSTOMER TO SUPPLY DISCONNECT SWITCH
  4. UNIT MUST BE GROUNDED

REVISIONS			
NO.	DESCRIPTION	DATE	CH'G BY

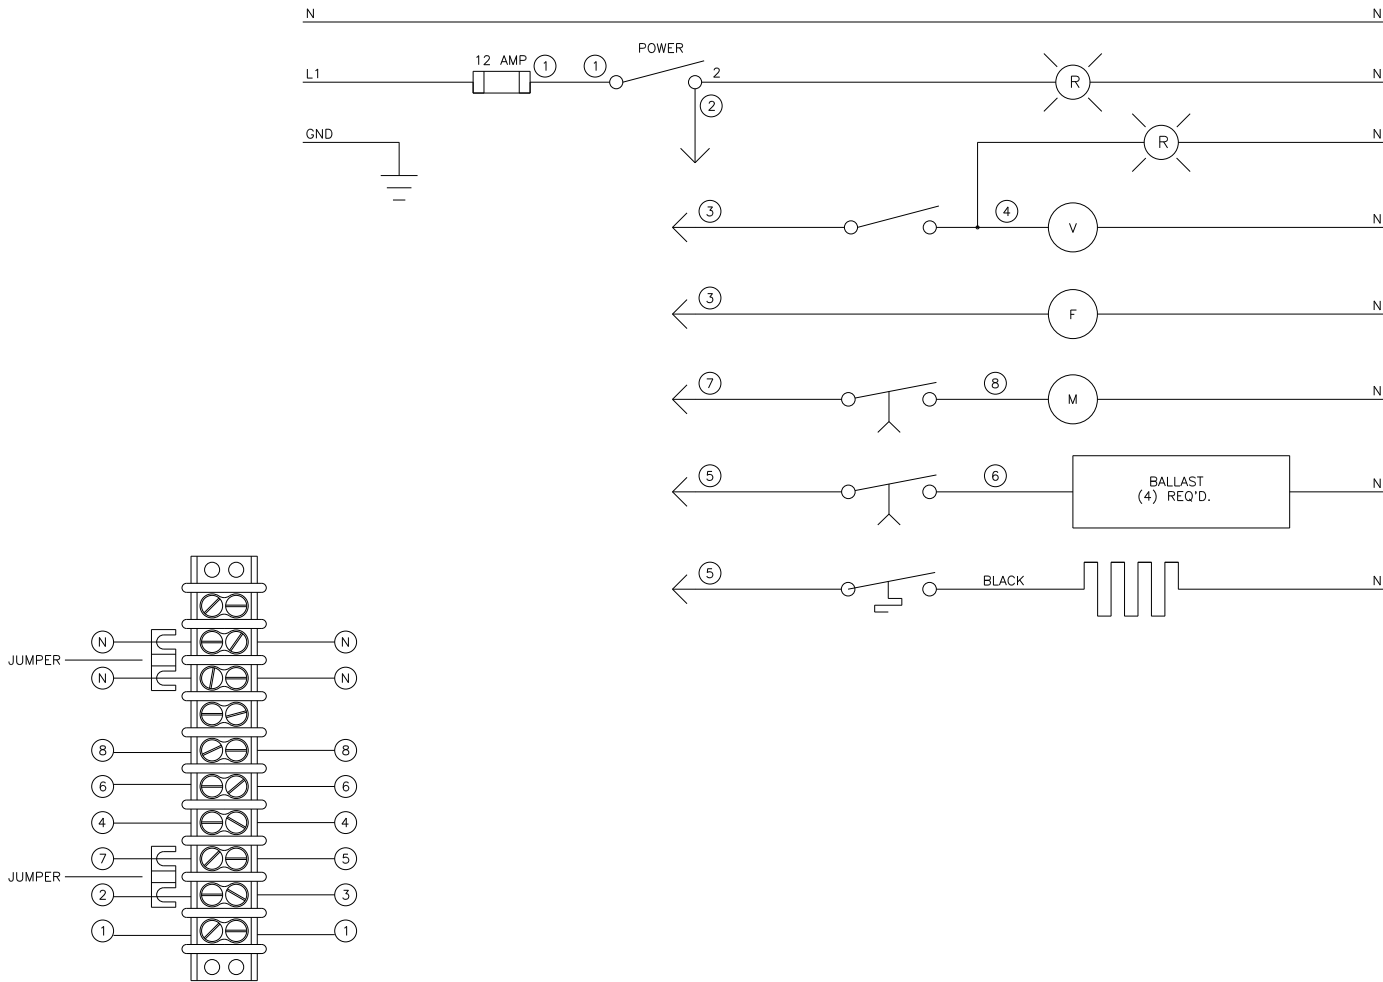

STARTING WITH S/N 0002

THIS PRINT IS THE PROPERTY OF ANDERSON & VREELAND, INC., BRYAN, OHIO. TO BE USED FOR PURPOSE INTENDED. IT IS NOT TO BE COPIED OR REPRODUCED WITHOUT THE WRITTEN PERMISSION OF ANDERSON & VREELAND, INC. AND MUST BE RETURNED TO ANDERSON & VREELAND, INC. WHEN SO REQUESTED.		
DO NOT SCALE DRAWING		
TOLERANCES		
FRACT.	DECIMAL	
$\pm 1/64$	.XX $\pm$ .01	.XXX $\pm$ .001
UNLESS OTHERWISE NOTED		
ANDERSON AND VREELAND, INC. BRYAN, OH. 43506 - (419) 636-5002		
12 X 12 ORBITAL 11		
ELECTRICAL 120V/1PH/60HZ		
SCALE:	FULL	DATE: 08-22-2005
DRN. BY:	JOHN V. LAW	PROJ. NO.: ACAD
CK'D:	KP	DWG. NO.: C9072019