NOTE:
1. ALL HOT LEGS TO NEUTRAL MUST READ 120 VOLTS ±10%
2. GREEN WIRE TO BE MECHANICAL GROUND WITHOUT GFI
3. CUSTOMER TO SUPPLY DISCONNECT SWITCH
4. UNIT MUST BE GROUNDED

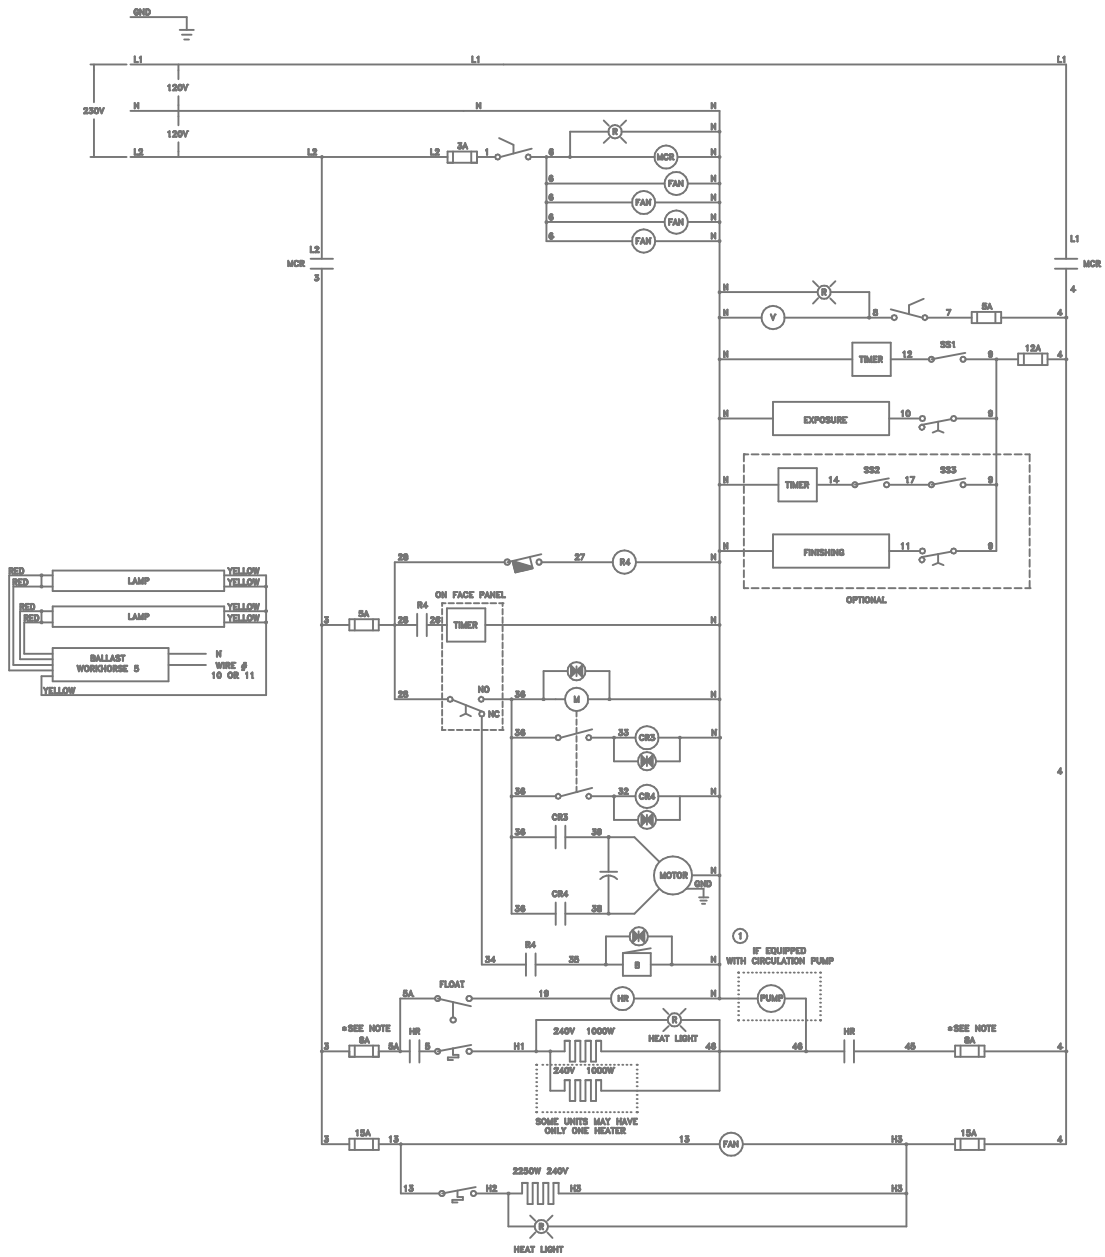



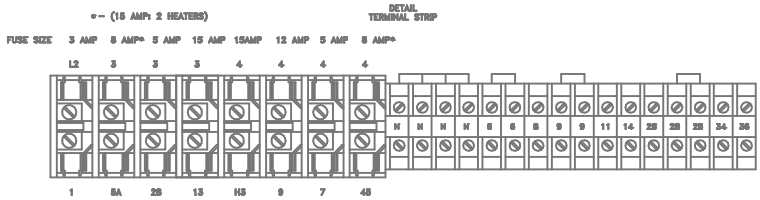





NO.	DESCRIPTION	DATE	CH'G BY
1	ADDED CIRCULATION PUMP	8/24/98	JVL
2	REMOVED GFI		
	STARTING W/ SN# 10-0032	11/9/98	JVL

REVISIONS

THIS PRINT IS THE PROPERTY OF ANDERSON & WREELAND OWO. TO BE USED FOR PURPOSE INTENDED. IT IS NOT TO BE COPIED OR REPRODUCED WITHOUT THE WRITTEN PERMISSION OF ANDERSON & WREELAND, INC. AND MUST BE RETURNED TO ANDERSON & WREELAND, INC. WHEN SO REQUESTED.

STARTING WITH S/N 10-0041

DO NOT SCALE DRAWING

TOLERANCES

FRACT.	DECIMAL
±1/64	.XX ±.01
	.XXX ±.001

UNLESS OTHERWISE NOTED

ANDERSON AND WREELAND, INC.
BRYAN, OH. 43506 - (419) 636-5002

24 X 30 ORIENTAL X

ELECTRICAL
230/1/60

SCALE: NONE
DATE: 08-11-2005
DRN. BY: JOHN V. LAW
PROJ. NO.: ADAD
CK'D: HRM
DWG. NO.: 08080079